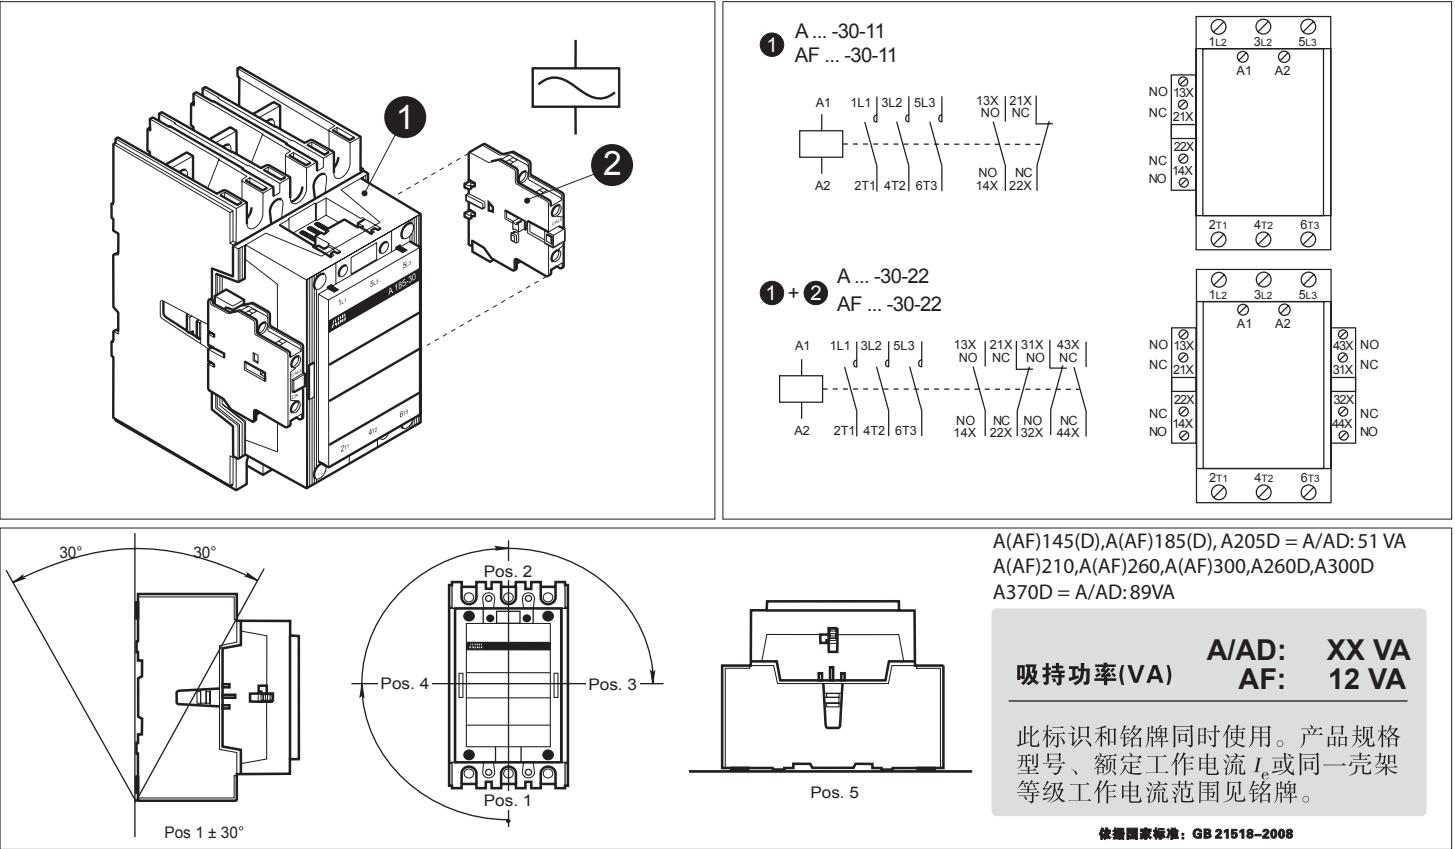


Operating instructions
Betriebsanleitung
Notice d'instructions
Instruktion
Istruzioni tecniche
Instrucciones de empleo
Ohje

Contactors
Schütze
Contacteurs
Kontaktorer
Contattori
Contactores
Kontaktori

1SFC 380003-89, 1(4), ed.E, April 2010



Warning! The operation, installation and servicing of this product must be carried out by a qualified electrician, following installation standards and safety regulations. Before operating the contactor, make sure that the control voltage supply corresponds with the coil marking. Wrong control voltage can damage the coil. Do not touch live parts. Danger!

Warnung! Die Inbetriebnahme und die Installation des vorhandenen Gerätes sowie jegliche Wartungsarbeiten müssen durch einen Fachelektriker, der die anerkannten technischen Regeln, die Montagenormen und die Sicherheitsvorschriften beachtet, durchgeführt werden. Vor Inbetriebnahme der Schütze prüfen ob Steuerspannung am Verwendungsort mit den aufgedruckten Spulenlängen übereinstimmt. Der Anschluss einer anderen Steuerspannung kann zur Zerstörung der Spule führen.

Attention! La mise en œuvre et l'installation de cet appareil et toute intervention doivent être effectuées par un électricien professionnel appliquant les normes d'installation et les règlements de sécurité. Avant la mise en marche des contacteurs, vérifier que la tension du circuit de contrôle correspond bien aux indications de la bobine. Le raccordement d'une tension différente peut mener à une destruction de la bobine. Ne pas toucher les pièces sous tension. Danger de mort!

Warning! Igångsättning och installation av apparaten samt alla ingrepp bör utföras av en kompetent elektriker enligt alla gällande installationsnormer och säkerhetsregler. Kontrollera före installation att kontaktorn att aktuell manöverspänning överensstämmer med spolens märkdata. Felaktig manöverspänning kan skada spolen. Beröring av spänningförande delar är förenat med livsfara.

Attenzione! La messa in opera, l'installazione di questo apparecchio ed ogni tipo di intervento devono essere effettuati da un elettricista professionista il quale applichi le regole del mestiere, le norme di installazione e i regolamenti di sicurezza. Prima della messa in servizio del contattore, verificare che la tensione del circuito di comando corrisponda esattamente a quella indicata sulla bobina.

L'alimentazione con una tensione diversa, può provocare la distruzione della bobina. Non toccare le parti attive. Pericolo di vita!

Atención! La puesta en aplicación, la instalación de este aparato y cualquier intervención deben realizarse por un electricista profesional que aplique las reglas del oficio las normas de instalaciones y la reglamentación de seguridad. Antes de la puesta en servicio del contactor, comprobar si coinciden la tensión de mando con los datos impresos en la bobina. La conexión de otra tensión de mando puede producir la destrucción de la bobina. Las partes bajo tensión no deben tocarse. Peligro de muerte!

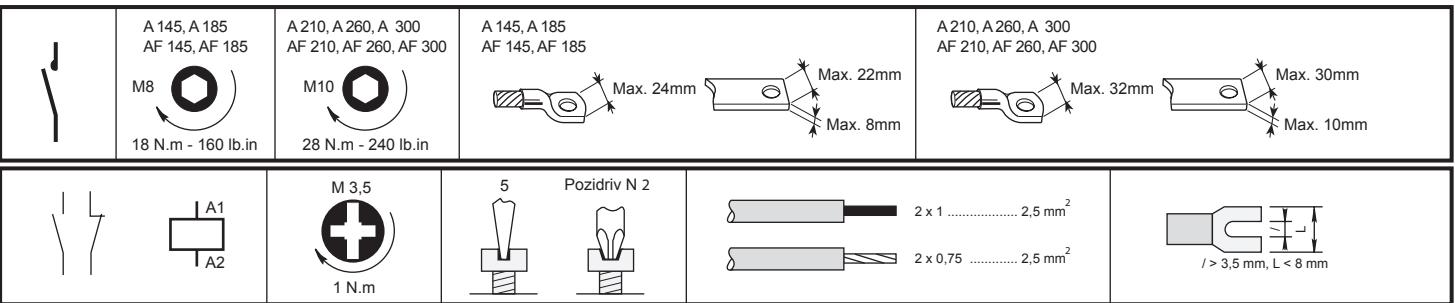
注意！所有对此产品的操作、安装及维护，均需由合格的电气工程师，在遵循安装标准及安全准则的条件下进行。在运行之前，确认控制电压与线圈上标识一致，否则会损坏线圈。不要接触带电部分。危险！

According to UL 508:

Use wire Cu 75°C only.

A(F) 145, 185: Enclosure with min. dimension 24 by 20 by 10 inches should be used.

A(F) 210, 260, 300: Enclosure with min. dimension 36 by 30 by 12 inches should be used.



AF-Contactors

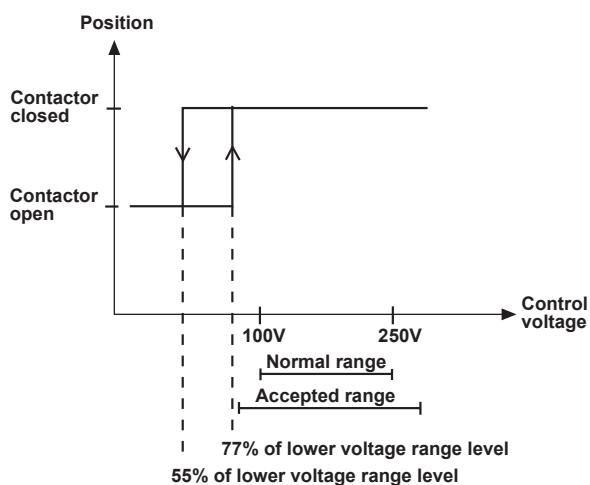
General

The AF-Contactors have the same dimensions and nearly the same appearance as the A-Contactors of equal rating. The only difference is that AF-Contactors are fitted with an electronic coil interface. For a given coil, this interface allows the contactor to accept a very wide voltage range as well in d.c. as in a.c., 50 or 60 Hz.

Control with voltage on A1 and A2

Operating of AF-Contactors can be done as with conventional contactors by applying and removing voltage on A1 and A2. The function limits are very exact compared with a conventional contactor and there is a built in hysteresis in the function.


Note: Minimum length of the starting pulse=70 ms




AF-Contactors comply with international standards IEC 947-1, IEC 947-4-1 and European standards EN 60 947-1, EN 60 497-4-1. Moreover in environment 2, they meet the electromagnetic compatibility rules (EMC): additional clauses A11 and A11 to above mentioned EN standards. Using these materials in environment 1 may lead to radio-interferences requiring the use of additional mitigation methods. Here are the definitions given in the additional clause A11 to standard EN 60 497-1.

Environment 1: "Mainly relates to low-voltage public networks such as residential, commercial and light industrial locations/installations. Highly disturbing sources such as arc welders are not covered by this environment".









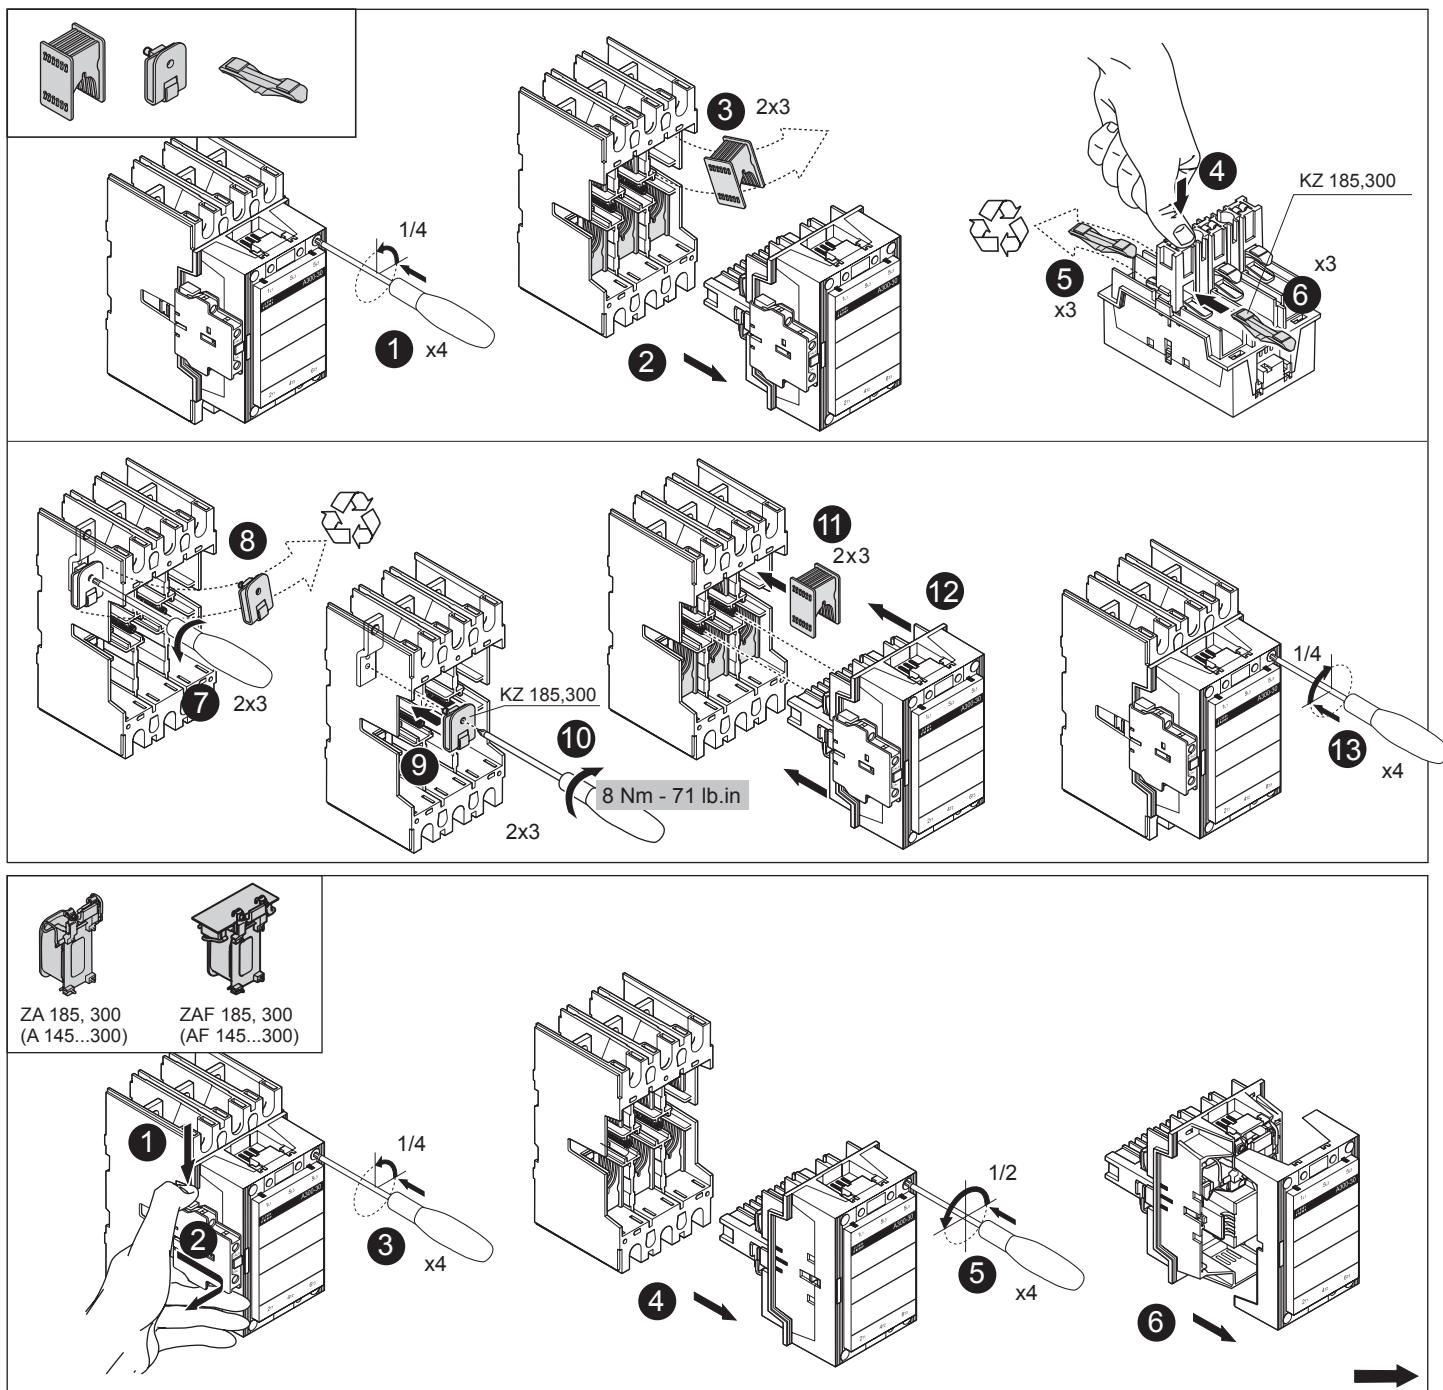
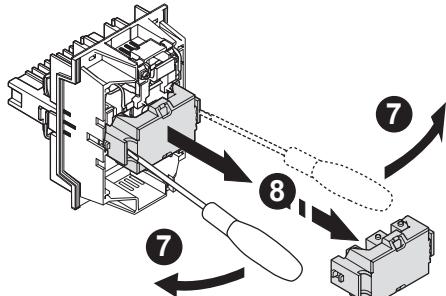
Environment 2: "Mainly relates to low-voltage industrial networks/locations/installations including highly disturbing sources".





A 145, A 185
AF 145, AF 185


ZAF 185 → AF 145, 185
ZAF 300 → AF 210, 260, 300

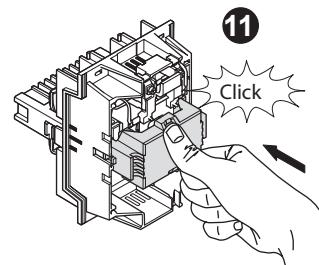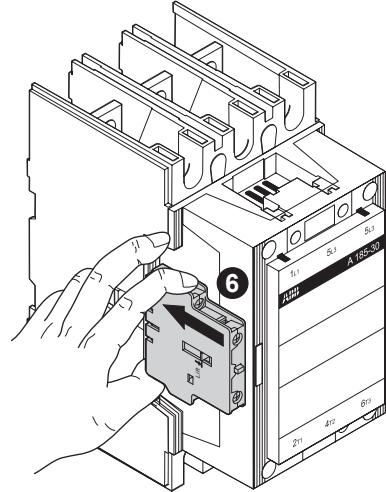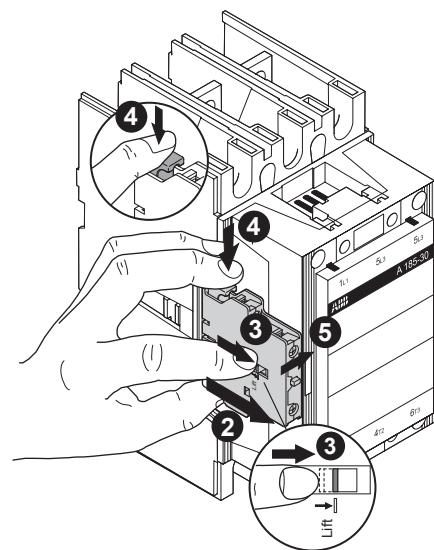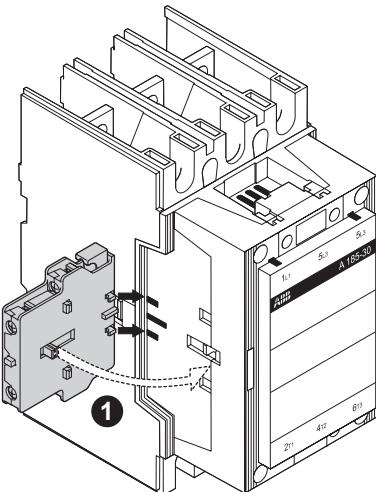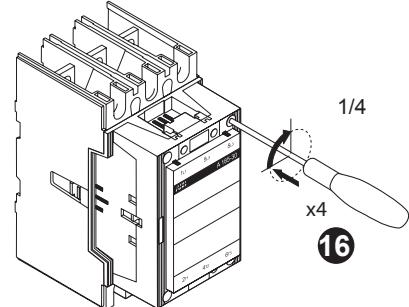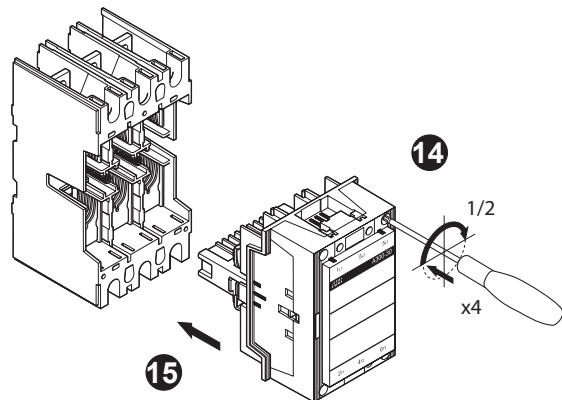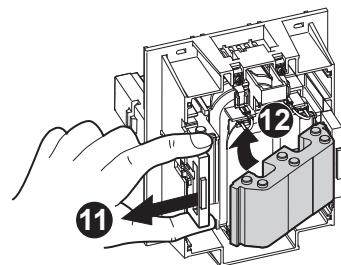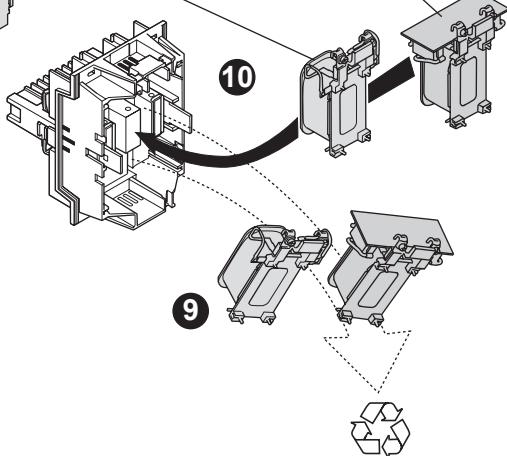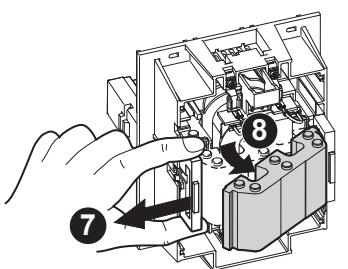ZA 185 → A 145, 185
ZA 300 → A 210, 260, 300


A 210, A 260, A 300
AF 210, AF 260, AF 300

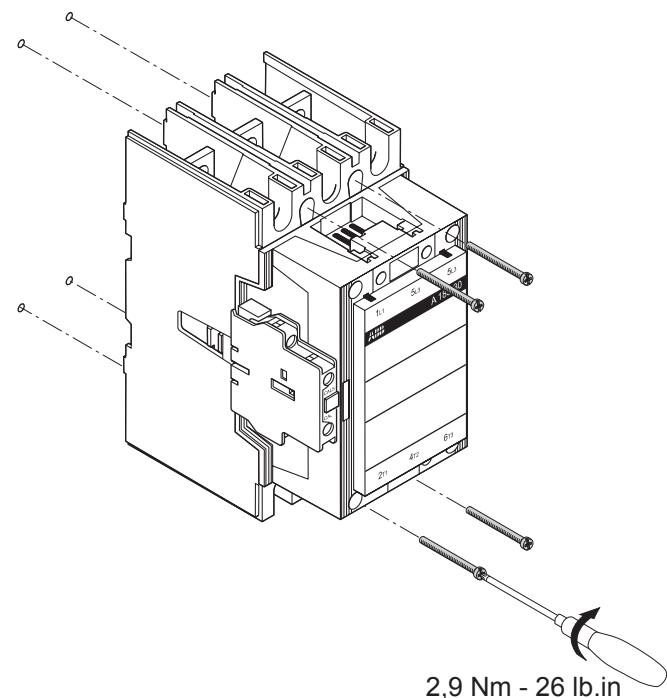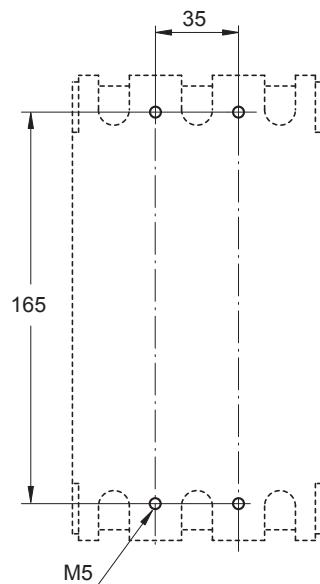
A145, A185
AF145, AF185



A210, A260, A300
AF210, AF260, AF300

